

TEST REPORT

Lucideon Reference: 153788 (Emails 26.8.15 &17.9.15)/Ref. 2/Supp1

Project Title: Determination of Racking Resistance in Accordance with BS EN 594:2011

Client: Black Mountain Insulation Ltd
Bradwell Hall
Bradwell on Sea
Essex
CM0 7HX

For the Attention of: Gordon Pirret

Author(s): Miss Lisa Cobden

Report Date: 09 May, 2018

Purchase Order No.: None

Work Location: Lucideon UK

This report supersedes the report issued on 14.04.16.



Miss Joanne Booth
Consultancy Team
Reviewer



Miss Lisa Cobden
Consultancy Team
Project Manager



CONTENTS

	Page
1 INTRODUCTION	3
2 TEST PROGRAMME	3
3 SAMPLE DESCRIPTION	3
4 TEST PREPARATION	3
5 METHOD OF TEST	4
5.1 0 kN Vertical Load per Stud	4
6 RESULTS	4
7 DISCUSSION	4
TABLES	5
PLATES	6-7
CHART	8

1 INTRODUCTION

Black Mountain Insulation Ltd supplied MagPly sheathing boards to be installed onto timber frame panels made at Lucideon, to establish racking resistance in accordance with BS EN 594:2011 Timber Structures – Test Methods. Racking strength and stiffness of the panel were determined according to Section 6.5 of BS EN 52681-6.1:1996.

2 TEST PROGRAMME

The samples were received and tested under racking load when subjected to the following loading conditions:

Panel Reference	Vertical Top Load at 600 mm Centres (kN)	Tests	Sheathing Board Thickness (mm)	Perimeter Nailing Centres (mm)	Intermediate Nailing Centres (mm)
MagPly Sheathing Board	0	1	9	50	150

3 SAMPLE DESCRIPTION

Each timber frame panel was of overall size 2400 x 2400 mm and comprised 38 x 89 mm C16 studs at nominally 600 mm centres, together with a single bottom rail and single top rail. A head binder was used above the top rail but not fixed to the sheathing.

The studs were fixed to the top and bottom rail using 2 x 3.1 mm x 90 mm long ring shank nails per stud, at the base and top rails.

1.2 m x 2.4 m x 9 mm thick MagPly sheathing boards were nailed to the face of the timber frame at 50 mm centres to the perimeter and 150 mm centres to the internal studs, using 2.9 mm x 50 mm smooth nails.

4 TEST PREPARATION

100 mm diameter holes were cut in the base rail, centred at the anchorage points of the base rig. M16 x 150 mm long bolts were inserted through the holes with large steel plates attached (50 mm wide x 220 mm long x 10 mm thick).

The test panel was bolted to the test rig through a 38 x 89 mm C16 timber rail such that the bottom rail was fixed down by 5 No. M16 x 150 mm long bolts in line with BS EN 594:2011 and shown in Figure 2. The panel was laid flat in the test rig which had been bolted down to the laboratory strong floor. The panel was placed on Teflon coated timber packers to allow it to move freely when loading.

Hydraulic rams were fixed to the test rig at the panel header end such that they would be able to apply a vertical top load to the panel at the 600 mm centres.

In accordance with Figure 3 of BS EN 594:2011, linear voltage displacement transducers (LVDT's) were fixed in place so as to record horizontal deflection at the head of the panel (Displacement 1), at the base of the panel (Displacement 2) and to measure any uplift at the base of the panel (Displacement 3). The positions are shown in Figure 2 along with a general view of the test arrangement.

The temperature and humidity as measured by a calibrated hygrometer was 21.8°C and 55.6% RH.

5 METHOD OF TEST

5.1 0 kN Vertical Load per Stud

Using hydraulic rams linked via a common manifold, a vertical pre-load of 1 kN/stud was applied to the panel and left for 2 minutes prior to removal. The panel was then allowed to recover for 5 minutes before applying a racking load at a loading rate such that 90% of the maximum load of the panel was achieved within 300 seconds \pm 200 seconds.

6 RESULTS

The ultimate racking load, the racking stiffness and basic test racking resistance are given in Table 1. The density and moisture content of the timber frames are given in Table 2 respectively.

Graphs of applied racking load against deflection are given in Chart 1.

The typical failure modes are shown in Plate 2.

7 DISCUSSION

According to BS 5268-6.1¹ a Category 1 material (9.5 mm plywood, 9.0 mm medium board, 12.0 mm chipboard, 9.0 mm OSB) nailed at a maximum spacing of 150 mm on perimeter and 300 mm on internal studs should give a Racking resistance of 1.68 kN/m.

The 9 mm thick MagPly sheathed timber frame panels nailed at 50 mm centres to the perimeter and 150 mm centres to the internal studs achieved calculated basic test racking resistance values of 5.90 kN/m with no vertical load assuming 3 samples had been tested or 5.08 kN/m based on one sample tested.

¹ BS 5268-6.1 Structural use of timber. Part 6 code of practice for timber frame walls. Part 6.1 Dwellings not exceeding seven stories



Table 1 - Summary of Racking Loads for Panels Tested with 9 mm MagPly Sheathing Boards Fixed at 50 mm Centres to the Perimeter and 150 mm Centres to the Internal Studs

Panel	Racking Stiffness (N/mm)	Test Racking stiffness Load (N/mm)	F Max (kN)	Calculated Racking Strength (kN)	Calculated Basic Test Racking Resistance to BS 5268-6.1 (kN/m)	Tabulated Basic Test Racking Resistance to BS 5268-6.1 (kN/m)	Mode of Failure
1	2541	14180	25.67	14.92	5.90 ¹	1.68	Withdrawal of leading stud with splitting of base rail and failure of sheathing board at base rail- fixings pulling through.
1	2541	12197	25.67	12.84	5.08 ²	1.68	

Note 1: This value has been calculated using a k109 modification factor of 0.93 assuming 3 No. tests have been carried out.

Note 2: This value has been calculated using a k109 modification factor of 0.80 based on 1 No. test having been carried out.

Table 2 - Density and Moisture Content of the Timber Frames

Sample No.	Moisture Content (%)	Density (kg/m ³)
1	11.3	419



Plate 1 - General View of Racking Test Arrangement



Plate 2 – Typical Mode of Failure after 0 kN Vertical Top Load Tests


NOTE: The results given in this report apply only to the samples that have been tested.

END OF REPORT



Chart 1 - Load-Deflection Curve for Racking Tests on 9 mm Magply Sheathing Boards with 50/150 mm Nailings with 0 kN Top Load

Test Report: 153788 Ref. 2/Supp1

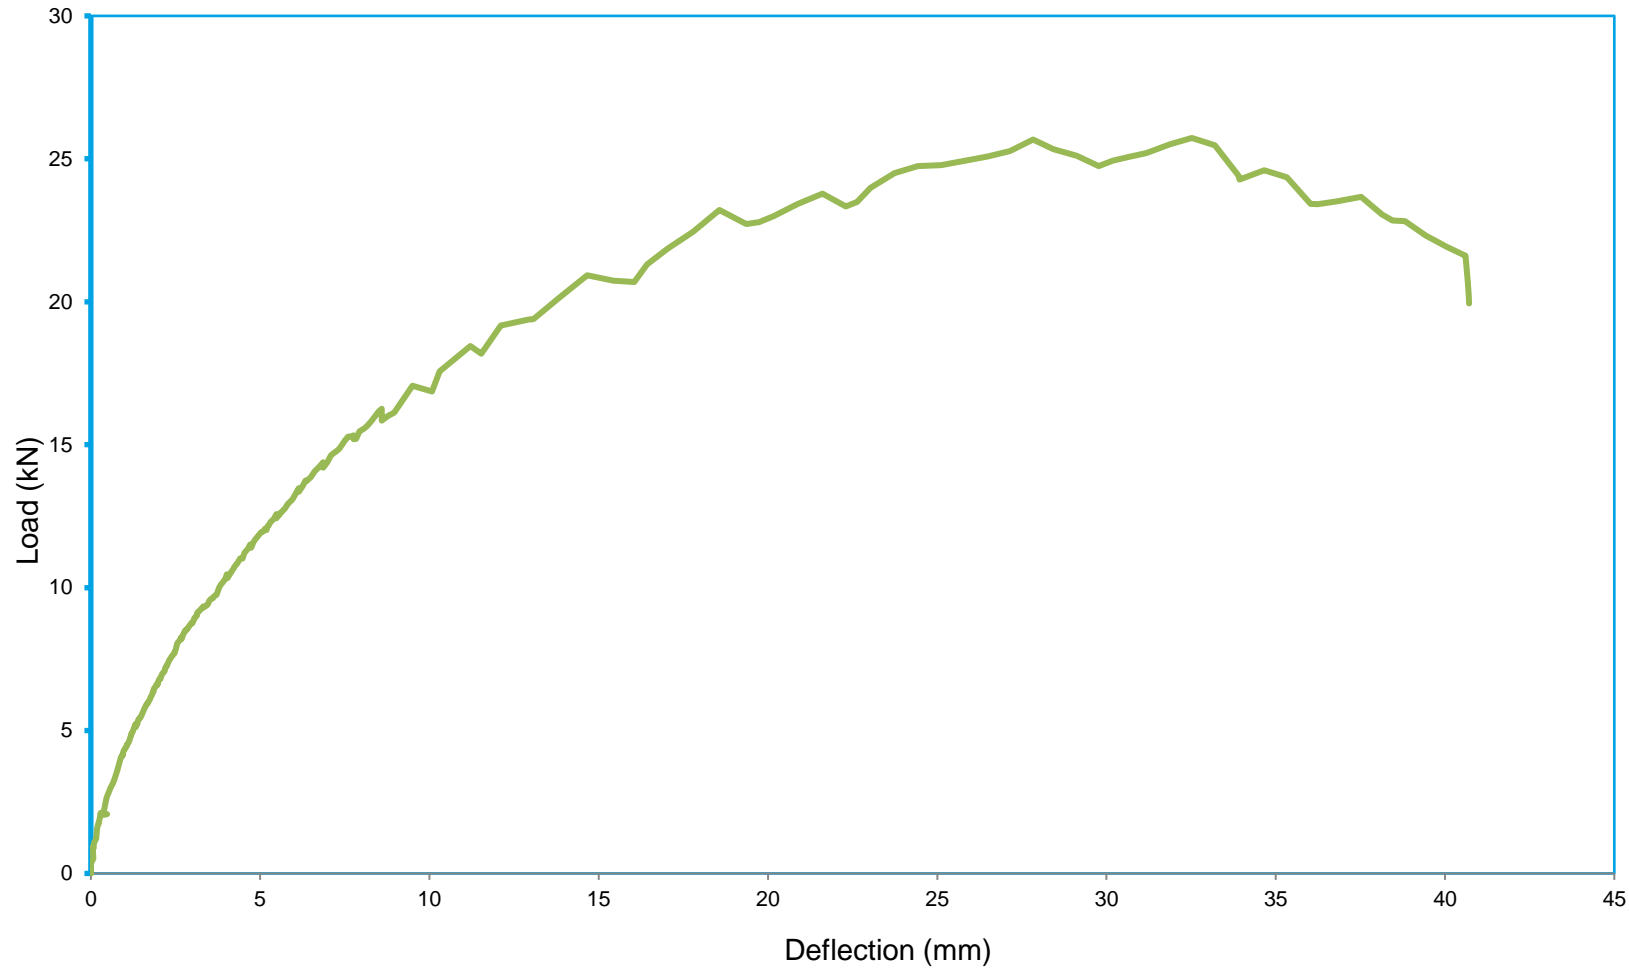

Key

— Test 1